

Model 350XL

Double Check Valve Assembly

Application

Ideal for use where Lead-Free* valves are required. Designed for installation on potable water lines to protect against both backsiphonage and backpressure of polluted water into the water supply. Assembly shall provide protection where a potential health hazard does not exist.

Standards Compliance (Horizontal & Vertical)

- ASSE® Listed 1015
- · cUPC® Listed
- CSA® Certified B64.5
- AWWA Compliant C510
- Approved by the Foundation for Cross Connection Control and Hydraulic Research at the University of Southern California
- UL® Classified (less shut-off valves only)
- · C-UL® Classified (less shut-off valves only)
- Meets the requirements of NSF/ANSI/CAN 61 and 372*
- *(LESS THAN 0.25% WEIGHTED AVERAGE LEAD CONTENT)

Materials

Main valve body Low Lead Cast Bronze,

ASTM B 584 (3/4-1")

Reinforced Nylon Housing

Stainless Steel, 300 Series **Fasteners** Elastomers Silicone (FDA Approved)

Buna Nitrile (FDA Approved)

Internals Delrin

Springs Stainless Steel, 300 series


Ball Valves Low Lead Cast Bronze, ASTM B 584


Struts Stainless Steel, 300 Series Handles Stainless Steel, 200 Series

Features

Sizes: 3/4", 1", 1-1/4", 1-1/2", 2" Maximum working water pressure 175 PSI Maximum working water temperature 180°F Hydrostatic test pressure

350 PSI End connections Threaded ANSI B1.20.1




















Options

(Suffixes can be combined)

- with full port QT ball valves (standard)
- \Box L - less ball valves, male pipe thread (3/4" - 1" only)
- □ FT - with integral male 45° flare SAE test fitting
- □ S - with Model SXL lead-free bronze "Y" type strainer

Accessories

- ☐ Repair kit
- ☐ Thermal expansion tank (Model XT)
- ☐ QT-SET Quick Test Fitting Set
- ☐ Winterizing Blow out/Flush fitting (RK34-350BOF,
- ☐ RK1-350BOF or RK114-350-375BOF)

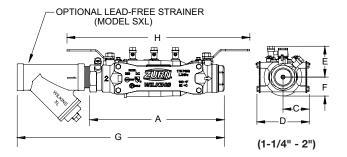


Dimensions & Weights (do not include pkg.)


		DIMENSIONS (approximate)													WEIGHT						
MODEL 350XL SIZE		А		B LESS BALL VALVES		С		D		E		F		G		н		LESS BALL VALVES		WITH BALL VALVES	
in.	mm	in.	mm	in.	mm	in.	mm	in.	mm	in.	mm	in.	mm	in.	mm	in.	mm	lbs.	kg	lbs.	kg
3/4	20	11	279	65/8	168	1 7/8	48	3 3/4	95	3	76	1 1/4	32	15 1/8	384	11 7/16	291	2.3	1.0	4.3	2.0
1	25	12 1/4	311	7	178	2 1/16	52	4 1/8	105	3 1/4	83	1 3/4	45	17	431	12 5/16	313	3.0	1.4	6.0	2.7
1-1/4	32	14 7/8	378	N/A	N/A	3 1/8	80	6 1/4	159	3 3/4	95	2 1/4	57	20 1/2	521	18 1/2	470	N/A	N/A	19	8.6
1-1/2	40	15 1/4	387	N/A	N/A	3 1/8	80	6 1/4	159	3 3/4	95	2 1/4	57	22	559	20 1/4	514	N/A	N/A	20	9.1
2	50	16	406	N/A	N/A	3 1/8	80	6 1/4	159	3 3/4	95	2 1/4	57	24	609	20 3/4	527	N/A	N/A	22	10

Rev M Date: 12/23 Document No. BF-350XL Product No. Model 350XL Patent zurn.com/patents

MODEL 350XL 3/4" & 1" (STANDARD & METRIC)

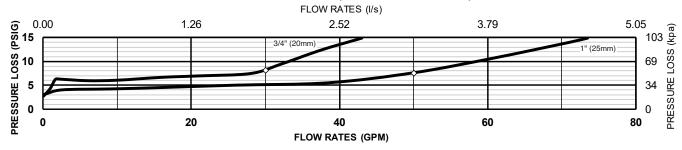


MODEL 350XL 1-1/4", 1-1/2" & 2" (STANDARD & METRIC)

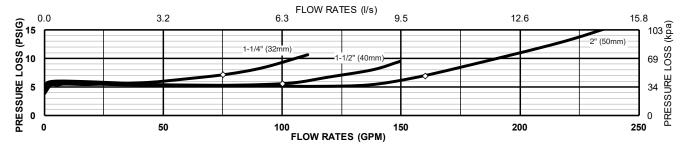


Typical Installation

Local codes shall govern installation requirements. To be installed in accordance with the manufacturers' instructions and the latest edition of the Uniform Plumbing Code. Unless otherwise specified, the assembly shall be mounted at a minimum of 12" (305mm) and a maximum of 30" (762mm) above adequate drains with sufficient side clearance for testing and maintenance. If installed below grade, be certain adequate drainage is provided to prevent the device from being submerged.

Capacity thru Schedule 40 Pipe										
Pipe size	5 ft/sec	7.5 ft/sec	10 ft/sec	15 ft/sec						
1/2"	5	7	9	14						
3/4"	8	12	17	25						
1"	13	20	27	40						
1 1/4"	23	35	47	70						
1 1/2"	32	48	63	95						
2"	52	78	105	167						

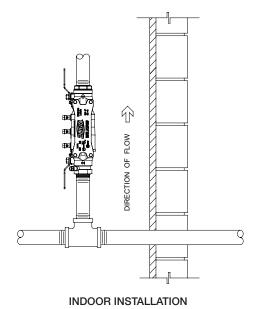

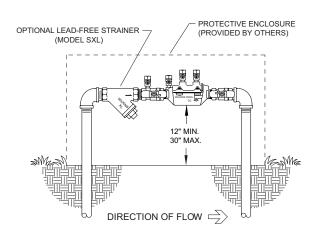

OUTDOOR INSTALLATION

Specifications

The Double Check Valve Backflow Preventer shall be certified to NSF/ANSI/CAN 61 and 372, shall be ASSE® Listed 1015, rated to 180°F, and supplied with full port ball valves. The main body shall be low lead Bronze for sizes 3/4" & 1", and Nylon for sizes 1-1/4" to 2". The housing shall be reinforced Nylon and the seat disc elastomers shall be silicone (FDA Approved). The first and second checks shall be accessible for maintenance without removing the device from the line. The Double Check Valve Backflow Preventer shall be a ZURN WILKINS Model 350XL.