



DOES THE AIR HANDLER INSTALL NEED A REFRIGERATION DETECTION KIT?

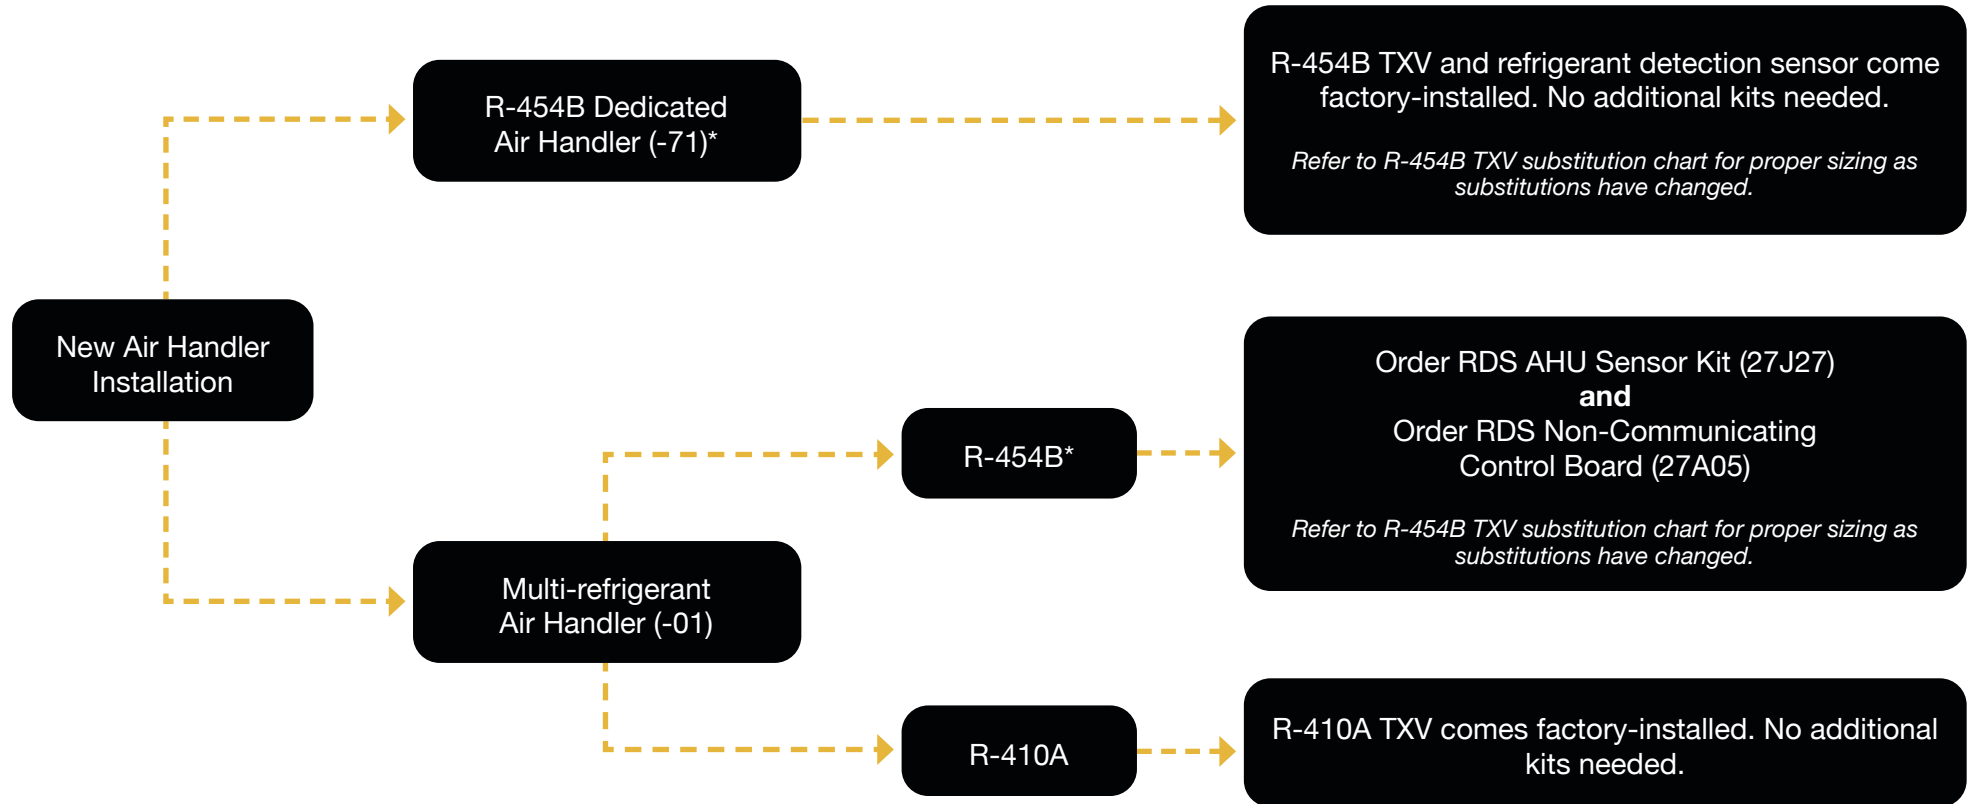

**For secondary joints, please see the air handler installation instructions for additional requirements.
RDS boards and sensors are exclusively for use with Allied Air equipment.*

DOES THE COIL INSTALL NEED A REFRIGERATION DETECTION KIT?

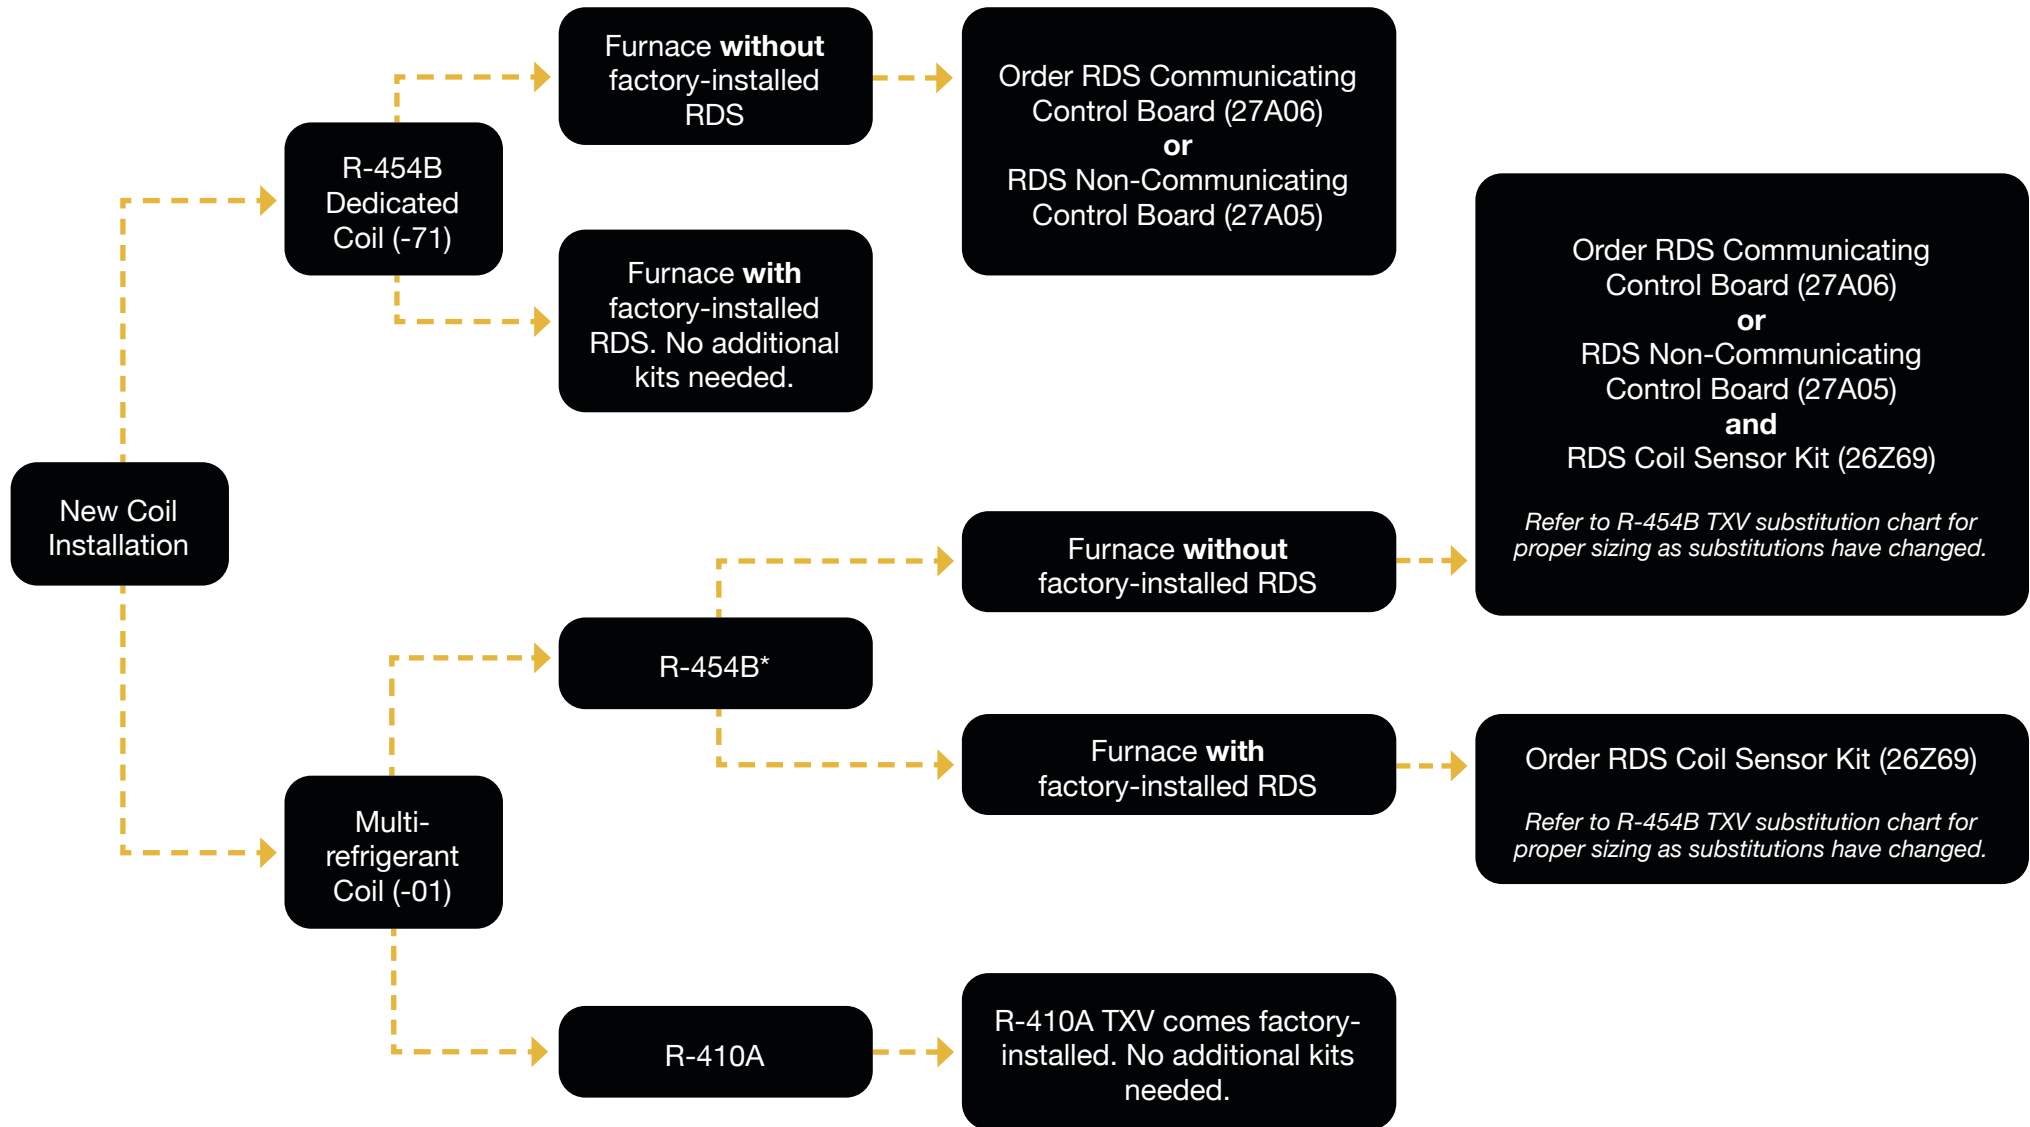

**For secondary joints, please see the coil installation instructions for additional requirements.
RDS boards and sensors are exclusively for use with Allied Air equipment.*

R-454B TXV
SUBSTITUTION CHART



Size	Order Number
18/24	26Z70
24	
30	
30/36	
36	
42	26Z71
48	
49	
50/60	26Z72
60	

NOTE - Additional components are required for R-454B Conversion. See Optional Accessories table.