

Model 730 & 735 LEAD-FREE*

Laboratory Faucet Vacuum Breaker (1/4" & 3/8")
Standards: ASSE @ 1035, CSA @ Certified
& IAPMO @ Listed (Model 730 only)

*This product contains a weighted average lead content less than 0.25% for wetted surfaces



❑ Installation ❑ Maintenance Instructions

INSTALLATION INSTRUCTIONS

CAUTION: Installation of Model 730 is not recommended for continuous pressure applications. Faulty installation could result in an improperly functioning device. For in-line continuous pressure applications, the Model 735 shall be used. Note: The Model 735 is for non-approval applications.


The installer should be sure the proper device has been selected for the particular installation.

ZURN WILKINS Laboratory Faucet Vacuum Breakers are designed for installations on laboratory faucets, where a potential health hazard exists due to backsiphonage of contaminated water from the sink or other apparatus.

Proper performance depends upon following these installation instructions and prevailing governmental and industry standards and codes. Failure to do so releases ZURN WILKINS of any liability that it might otherwise have with respect to that device.

1. Prior to Installation of the ZURN WILKINS Laboratory Faucet Vacuum Breaker, pipe lines should be flushed thoroughly to remove all sediment, pipe scale and other foreign material.
2. The devices can be installed in a horizontal position or vertical, in an accessible location to facilitate servicing. The valve should not be installed where discharge could cause damage to nearby equipment or property.
3. Install the valve with the arrow on the valve body pointing in the direction of the flow.
4. **CAUTION: Under certain backflow conditions, the Model 730 will discharge water from the vent holes. This discharge should be directed to a safe place of disposal with adequate ventilation per local and governmental codes. Under no circumstances should the vent holes be plugged.**
5. It is important that the devices be inspected periodically for any discharge from the vent holes which will provide a visual indication of the need for repair or replacement of the valve.

TYPICAL INSTALLATION

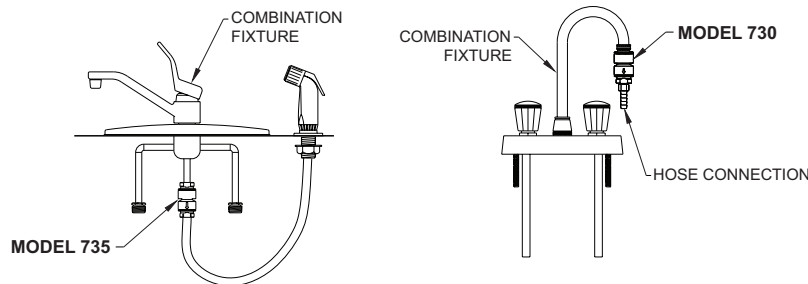

In-line continuous use

Faucet hose connection

⚠ **WARNING:** Cancer and Reproductive Harm - www.P65Warnings.ca.gov
⚠ **ADVERTENCIA:** Cáncer y daño reproductivo - www.P65Warnings.ca.gov
⚠ **AVERTISSEMENT:** Cancer et néfastes sur la reproduction - www.P65Warnings.ca.gov

WARRANTY: ZURN WILKINS Valves are guaranteed against defects of material or workmanship when used for the services recommended. If in any recommended service, a defect develops due to material or workmanship, and the device is returned, freight prepaid, to ZURN WILKINS within 12 months from date of purchase, it will be repaired or replaced free of charge. ZURN WILKINS' liability shall be limited to our agreement to repair or replace the valve only.

ZURN WILKINS

1747 Commerce Way, Paso Robles, CA 93446 Phone:855-663-9876 Fax:805-238-5766

IS730 (REV. D 7/17)

www.zurn.com

Model 730 & 735 LEAD-FREE*

Laboratory Faucet Vacuum Breaker (1/4" & 3/8")
Standards: ASSE @ 1035, CSA @ Certified
& IAPMO @ Listed (Model 730 only)

*This product contains a weighted average lead content less than 0.25% for wetted surfaces



❑ Installation ❑ Maintenance Instructions

INSTALLATION INSTRUCTIONS

CAUTION: Installation of Model 730 is not recommended for continuous pressure applications. Faulty installation could result in an improperly functioning device. For in-line continuous pressure applications, the Model 735 shall be used. Note: The Model 735 is for non-approval applications.


The installer should be sure the proper device has been selected for the particular installation.

ZURN WILKINS Laboratory Faucet Vacuum Breakers are designed for installations on laboratory faucets, where a potential health hazard exists due to backsiphonage of contaminated water from the sink or other apparatus.

Proper performance depends upon following these installation instructions and prevailing governmental and industry standards and codes. Failure to do so releases ZURN WILKINS of any liability that it might otherwise have with respect to that device.

1. Prior to Installation of the ZURN WILKINS Laboratory Faucet Vacuum Breaker, pipe lines should be flushed thoroughly to remove all sediment, pipe scale and other foreign material.
2. The devices can be installed in a horizontal position or vertical, in an accessible location to facilitate servicing. The valve should not be installed where discharge could cause damage to nearby equipment or property.
3. Install the valve with the arrow on the valve body pointing in the direction of the flow.
4. **CAUTION: Under certain backflow conditions, the Model 730 will discharge water from the vent holes. This discharge should be directed to a safe place of disposal with adequate ventilation per local and governmental codes. Under no circumstances should the vent holes be plugged.**
5. It is important that the devices be inspected periodically for any discharge from the vent holes which will provide a visual indication of the need for repair or replacement of the valve.

TYPICAL INSTALLATION

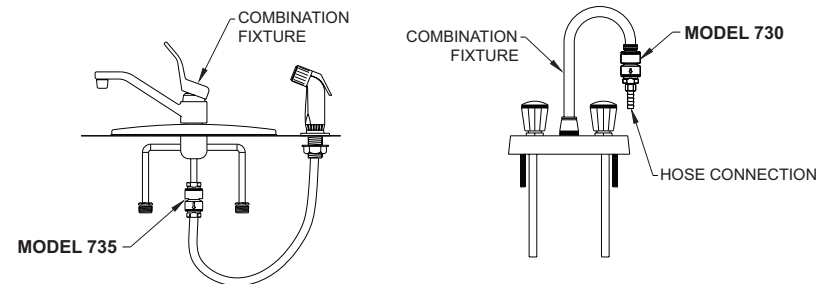

In-line continuous use

Faucet hose connection

⚠ **WARNING:** Cancer and Reproductive Harm - www.P65Warnings.ca.gov
⚠ **ADVERTENCIA:** Cáncer y daño reproductivo - www.P65Warnings.ca.gov
⚠ **AVERTISSEMENT:** Cancer et néfastes sur la reproduction - www.P65Warnings.ca.gov

WARRANTY: ZURN WILKINS Valves are guaranteed against defects of material or workmanship when used for the services recommended. If in any recommended service, a defect develops due to material or workmanship, and the device is returned, freight prepaid, to ZURN WILKINS within 12 months from date of purchase, it will be repaired or replaced free of charge. ZURN WILKINS' liability shall be limited to our agreement to repair or replace the valve only.

ZURN WILKINS

1747 Commerce Way, Paso Robles, CA 93446 Phone:855-663-9876 Fax:805-238-5766

IS730 (REV. D 7/17)

www.zurn.com