

❑ **81T231-WMSHWA**

**Exposed Hardwire Operated
3/4" Top Inlet Urinal Fixture**

- Polished chrome plated vandal resistant metal cover with 4" wallmount sensor
- Right or left-hand supply installation
- ADA compliant, automatic operation hardwire powered **H2OPTICS®** technology infrared sensor
- Infrared sensor range adjustment of 305mm-711mm (12"- 28"), in 4" increments, factory set at 508 mm (20") [± 50.8 mm (2")]
- Hardwire adaptor
- Vandal resistant copper tube conduit
- Adjustable 24 hour courtesy flush factory set to OFF
- 24 VAC input
- Electronic override button
- (110 to 24 VAC Transformer not included. See selection below for additional part number.)
- Quiet action, Teck® exposed diaphragm flush valve
- Chloramine resistant diaphragm
- Forged brass diaphragm retainer
- Renewable seat
- Polished chrome plated finish
- **External water conserving flush adjustment**, factory set to 1.9 litre (0.50 gal.)
- **1" FIP / 3/4" copper sweat inlet adaptor**, angle check stop with protecting cap
- Adjustable 121mm (4-3/4") plus or minus 11mm (7/16") inlet/valve outlet centers
- Vacuum breaker
- Cover tube, stainless steel wall flange, spud flange, spud nut, and 330mm (13") outlet tube
- **Recommended water supply:**
Minimum flowing pressure – 25 psi (172 kPa)
Minimum flow rate – 8 gpm (30 L/min)

Approvals:

- IAPMO listed to ASSE 1037/ ASME A112.1037/ CSA B125.37
- Indicates compliance to ICC/ANSI A117.1

(Contact Delta Representative for State and/or Local Approvals.)

Patented



Engineer/Architect Approval

Model Specified:

Approval:

Date:



81T231-WMSHWA

❑ **81T231-19-WMSHWA**

Same as 81T231-WMSHWA,
Not Field Adjustable



❑ **81T231-05-WMSHWA**

Same as 81T231-WMSHWA,
but set to 0.5 litre (0.125 gal.),
Not Field Adjustable




**Available Options
for Field Conversion**

❑ **061047A**

Hardwire with Battery Backup
See DSP-BB for detailed specification.

TRANSFORMERS	
060704A	110 to 24VAC Class II 20VA (for up to 5 Electronic Valves)
060771A	110 to 24VAC Class II 20VA (for up to 10 Electronic Valves)

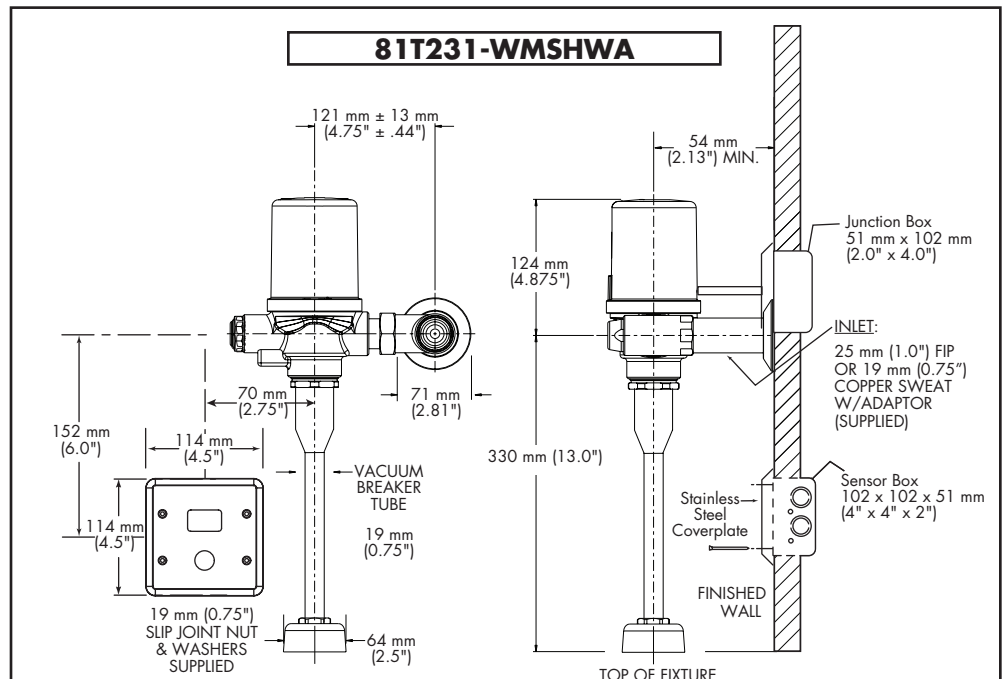

Note: For high and low pressure applications, please see page FEA-81T High Water Pressure note for more details.

Verify flow requirements with bowl manufacturer.

Note: Measurements may vary \pm 6mm (0.25")

Refer to www.specselect.com for individual models.

Note: Use this page as a product submittal sheet.